



e-ISSN: 2278-8875
p-ISSN: 2320-3765

International Journal of Advanced Research

in Electrical, Electronics and Instrumentation Engineering

Volume 10, Issue 11, November 2021

ISSN INTERNATIONAL
STANDARD
SERIAL
NUMBER
INDIA

Impact Factor: 7.282

☎ 9940 572 462

☑ 6381 907 438

✉ ijareeie@gmail.com

@ www.ijareeie.com



Design and Analysis of Power System Stability Using Feedback Control System Modelling Including HVDC Transmission Links

Piplesh Atrahe¹, Prof. Abhishek Dubey²

M.Tech Scholar, Department of Electrical & Electronics Engineering, Bhopal Institute of Technology & Science, Bhopal, India¹

Assistant Professor, Department of Electrical & Electronics Engineering, Bhopal Institute of Technology & Science, Bhopal, India²

ABSTRACT: HVDC systems offer better controllability and improvement of global power-system stability, there is also an increased risk for local instabilities which can either start as parasitic small signal oscillations, or concurrent commutation failure of converters consequently impair voltage quality or cause high over-voltage at the converter ac buses. This paper propose a implementation based on a small-signal stability, voltage stability, and interaction phenomena of power systems with both line-commutated-converter HVDC (LCC-HVDC) and voltage-source-converter HVDC(VSC-HVDC) are addressed using the proposed implementation. This proposed work is implemented in MATLAB/SIMULINK environment.

KEYWORDS: MATLAB, Simulink, LCC, HVDC, Transmission links, power system, Stability.

I.INTRODUCTION

The increasing number of high-voltage dc (HVDC) transmission links, imposes the serious challenges on power system control and stability analysis. While some of HVDC systems offer better controllability and improvement of global power-system stability, there is also an increased risk for local instabilities which can either start as parasitic small signal oscillations, or concurrent commutation failure of converters consequently impair voltage quality or cause high over-voltage at the converter ac buses. To analyze the nature and causes of these instabilities, appropriate analytical models of power systems and HVDC links are required. The electro-magnetic transient programs (EMTPs), as time-domain simulation tools, demonstrate instabilities; however, they do not provide the analytical insight (e.g., information about participants in instability or stability margins) needed for optimal system design. In addition, these programs have practical simulation restrictions on the extent of the ac system. The conventional transient stability programs (TSPs), which use phasor modeling techniques, do not have these aforementioned problems, but they cannot directly represent the faster transients characterizing the HVDC systems. These models are usually used in local studies, where a small portion of power system including HVDC converter is modeled in detail and the rest of the power system is replaced by an equivalent simple circuit.

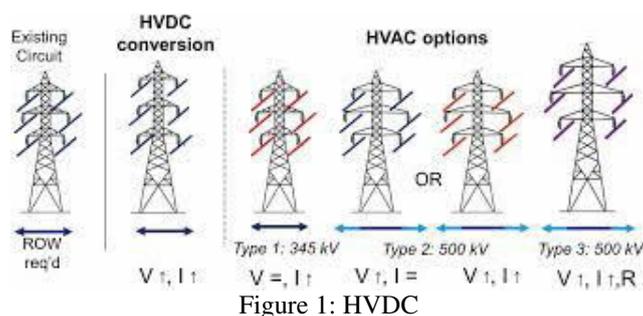


Figure 1: HVDC



However, when the number of HVDC converters (and/or other power-electronic devices) is increased, the high-frequency interaction between different devices will be so complicated that local analysis may not result in a reliable conclusion. Moreover, that the HVDC controller design might suffer from lack of an accurate power system model if only the dynamics of a small portion of it is regarded. On the one hand, considering dynamics of all power components and ac system results in a huge number of state variables, of which most of are in essential. On the other hand, all of the electrical network dynamics cannot be neglected while analyzing the interactions among HVDC converters (otherwise, the TSPs could have been used for the same purpose).

II. PROPOSED MODEL

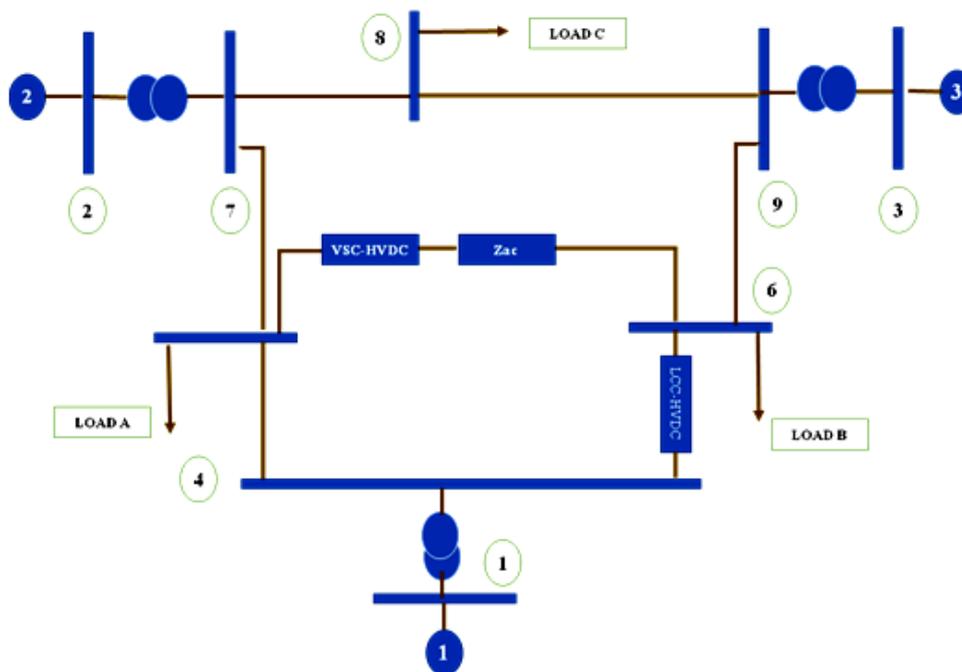


Figure 2: Flow Chart

High-voltage DC transmission based on voltage source converters (VSC-HVDC) presents a solution for many problems face nowadays by power networks, such as, network congestions, grid re-enforcements, wind farms connection, multi-terminal operation and asynchronous connections. Currently, there are two established approaches for the construction of a VSC-HVDC system. The first approach uses a standard two-level converter or a neutral-point clamped converter with forced commutated devices such IGBTs. This approach imposes a high insulation requirement on the interfacing transformer due to the high dv/dt that results from switching high voltage with relatively low switching frequencies. This arrangement also requires fairly large filters at the output to attenuate the switching frequency components from the output voltage at the point of common coupling. The second approach uses a two-switch modular multilevel converter with medium voltage devices such as 4.5 kV IGBTs. This approach produces lower dv/dt (allowing the use of a transformer with standard insulation requirements) and significantly lower voltage harmonic distortion (which may eliminate the need for the AC filters).

To develop the FCS model for entire power system, it is necessary to model the ac network as a hybrid model as developed. The hybrid model of the ac network means that the model is separated into two parts, namely, the dynamic and static parts. The dynamic part or dynamic area is where the HVDC converters and their surrounding ac components, such as the ac lines and transformers, are modeled dynamically using the space vector theory. The static part is the remaining part of the ac network where there are no HVDC converters. In this area, the ac components are modeled as constant admittances using the phasor theory. The electric parts of the input devices inside block I have two input vectors and one output vector. One of the input vectors originates from the control systems in K and the other one, which is the power vector, originates from the ac network in N. The output vector yin fed to the ac network in N



contains the amplitudes and angles of the input device alternating voltages. The VSC-HVDC outputs are the rectifier alternating voltage amplitude, rectifier direct voltage, rectifier alternating current vector, inverter alternating voltage amplitude, inverter active power, and the inverter alternating current vector, respectively. It must be analyzed that the VSCs alternating current vectors and are used in high-pass filters in the block for oscillations damping purposes.

III. SIMULATION RESULTS

The implementation of the proposed algorithm is done over MATLAB 8.3. The signal processing toolbox helps us to use the functions available in MATLAB Library for various methods like Windows, shifting, scaling etc

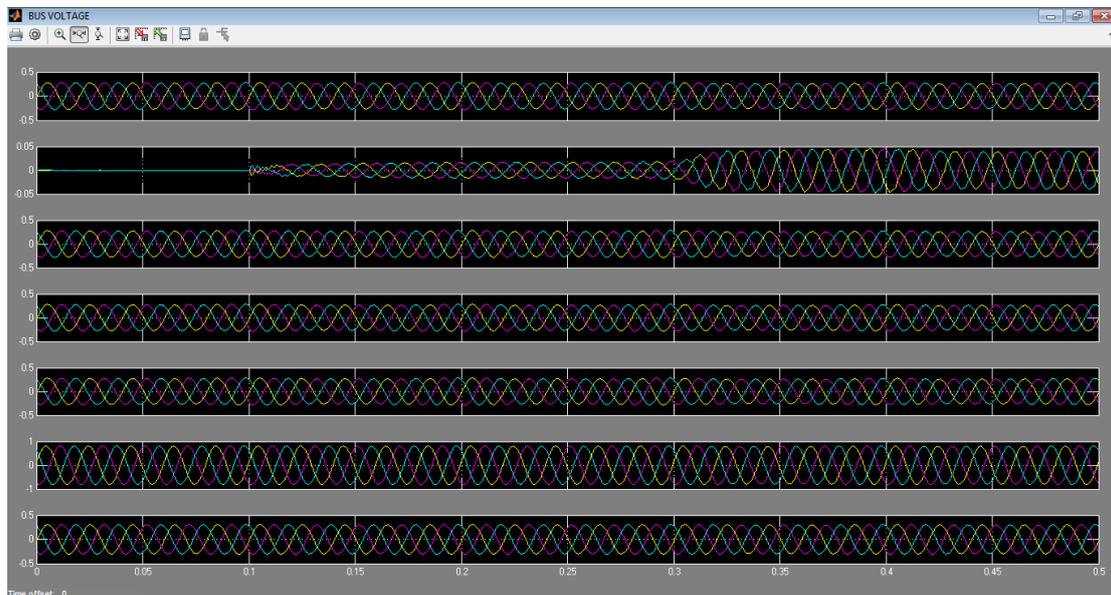


Figure 3: Bus voltage waveform

Bus voltage is the voltage on a Bus bar. Bus bars are rigid copper bars (mostly) into which all the generated current (generated from multiple alternators in AC system or from rectifiers in DC system) is fed and through which it is then distributed or further processed.

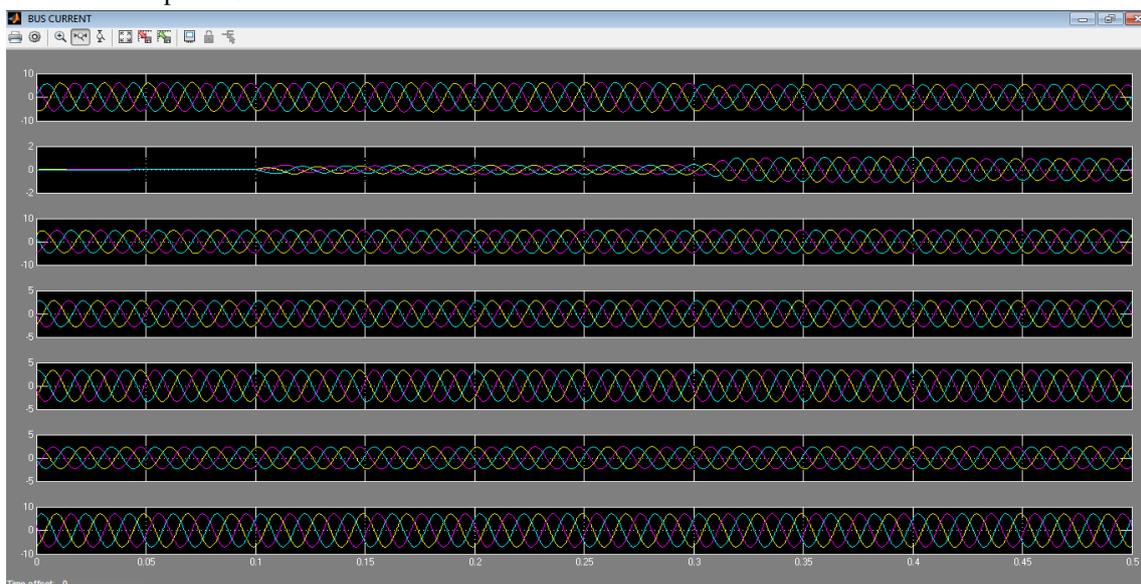


Figure 4: Bus current waveform

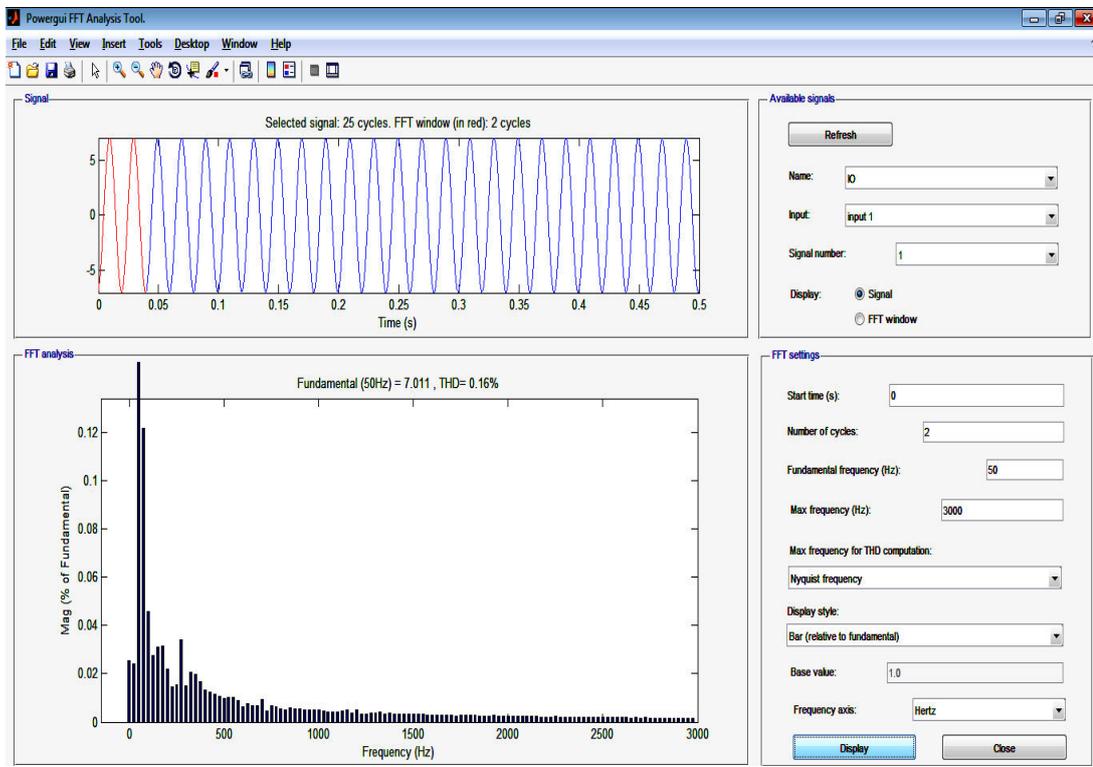


Figure 5: THD for bus 9 current waveform

The total harmonic distortion use for the measurement of the harmonic distortion present in a signal and is defined as the ratio of the sum of the powers of all harmonic components to the power of the fundamental frequency.

Table 1: Simulation Parameters

Sr No	Parameters	Value
1	Signal Cycle	25
2	FFT window cycle	2
3	Amplitude	5
4	Total harmonic distortion	0.16%
5	Frequency	3000Hz

Table 2: Results Comparison

Sr No	Parameters	Previous Results	Proposed Results
1	Real power	1 pu	1.5 pu
2	Reactive power	-0.8 pu	-1 pu
3	THD	0.57%	0.16%

Therefore the proposed model provides the sending and receiving end frequencies are independent. Transmission distance using DC is not affected by cable charging current. The installation is isolated from mainland disturbances, and vice versa. Power flow is fully defined and controllable. Low cable power losses obtain. Higher power transmission capability per cable.



IV. CONCLUSION

This paper proposed of power system stability using feedback control system modelling including HVDC transmission links model. It will not be necessary to change the circuit breakers in the existing network. HVDC can carry more power for a given size of conductor. It is also use for implementing stability interactions among multiple power-electronics devices in the power system from a feedback control theoretic perspective. To make FCS model be applicable for large power system, a hybrid model of ac network was adopted.

REFERENCES

1. D. Kwon and Y. Kim, "Optimal Data-Driven Control of an LCC HVDC System for Real-Time Grid Frequency Regulation," in IEEE Access, vol. 8, pp. 58470-58482, 2020, doi: 10.1109/ACCESS.2020.2981598.
2. P. Agnihotri, A. Kulkarni, A. Gole, B. Archer and T. Weekes, "A Robust Wide-Area Measurement-Based Damping Controller for Networks With Embedded Multiterminal and Multiinfeed HVDC Links," 2019 IEEE Power & Energy Society General Meeting (PESGM), 2019, pp. 1-1, doi: 10.1109/PESGM40551.2019.8973954.
3. T. N. Pham, H. Trinh and A. M. T. Oo, "Distributed Control of HVDC Links for Primary Frequency Control of Time-Delay Power Systems," in IEEE Transactions on Power Systems, vol. 34, no. 2, pp. 1301-1314, March 2019, doi: 10.1109/TPWRS.2018.2869984.
4. A. Elahidoost, L. Furieri, E. Tedeschi and M. Kamgarpour, "Optimizing HVDC Grid Expansion and Control for Enhancing DC Stability," 2018 Power Systems Computation Conference (PSCC), 2018, pp. 1-7, doi: 10.23919/PSCC.2018.8442753.
5. F. E. Alfaris and S. Bhattacharya, "Convertible static transmission controller model and supervisory vector control for operation under unbalanced grid conditions," 2017 IEEE Energy Conversion Congress and Exposition (ECCE), 2017, pp. 4806-4812, doi: 10.1109/ECCE.2017.8096817.
6. R. Vaid, P. Agnihotri, A. M. Gole, A. M. Kulkarni and X. Chen, "Wide-area control of multi-infeed HVDC links for targeted swing mode damping using special feedback signals," 13th IET International Conference on AC and DC Power Transmission (ACDC 2017), 2017, pp. 1-6, doi: 10.1049/cp.2017.0014.
7. P. Agnihotri, A. M. Kulkarni, A. M. Gole, B. A. Archer and T. Weekes, "A Robust Wide-Area Measurement-Based Damping Controller for Networks With Embedded Multiterminal and Multiinfeed HVDC Links," in IEEE Transactions on Power Systems, vol. 32, no. 5, pp. 3884-3892, Sept. 2017, doi: 10.1109/TPWRS.2017.2650559.
8. S. Ahmad and L. Khan, "Adaptive feedback linearization based HVDC damping control paradigm for power system stability enhancement," 2016 International Conference on Emerging Technologies (ICET), 2016, pp. 1-6, doi: 10.1109/ICET.2016.7813240.
9. T. N. Pham, H. Trinh and L. V. Hien, "Load Frequency Control of Power Systems With Electric Vehicles and Diverse Transmission Links Using Distributed Functional Observers," in IEEE Transactions on Smart Grid, vol. 7, no. 1, pp. 238-252, Jan. 2016, doi: 10.1109/TSG.2015.2449877.
10. A. Bidadfar et al., "Power System Stability Analysis Using Feedback Control System Modeling Including HVDC Transmission Links," in IEEE Transactions on Power Systems, vol. 31, no. 1, pp. 116-124, Jan. 2016, doi: 10.1109/TPWRS.2015.2407192.
11. S. Ahmad and L. Khan, "Adaptive Feedback Linearization Control for Power Oscillations Damping in AC/DC Power System," 2015 13th International Conference on Frontiers of Information Technology (FIT), 2015, pp. 199-204, doi: 10.1109/FIT.2015.43.
12. S. Ahmad and L. Khan, "Intelligent Feedback Linearization based adaptive control paradigm for damping power system oscillations," 2015 International Conference on Emerging Technologies (ICET), 2015, pp. 1-6, doi: 10.1109/ICET.2015.7389180.



INNO SPACE
SJIF Scientific Journal Impact Factor
Impact Factor: 7.282



ISSN INTERNATIONAL
STANDARD
SERIAL
NUMBER
INDIA



International Journal of Advanced Research

in Electrical, Electronics and Instrumentation Engineering

 **9940 572 462**  **6381 907 438**  **ijareeie@gmail.com**



www.ijareeie.com

Scan to save the contact details