



Quantify the Loss Reduction with Optimization of DGs Placement Using ICA Algorithm a Case Study on the Electrical Distribution Network of north Kerman

Mahdi Mozaffari Legha¹, Milad Askari Hashemabadi², Vajihe Sharifi³, Hassan Javaheri⁴ Mohammad Mozaffari Legha⁵

Department of Power Engineering, Javid University, Jiroft, Iran^{1,4}

Department of Electrical Engineering, Science and Research branch, Islamic Azad University, Kerman, Iran²

Department of mathematics, Rafsanjan Branch, Islamic Azad University, Rafsanjan, Iran³

Department of Electrical Engineering, Kerman Branch, Islamic Azad University, Kerman, Iran⁵

Abstract: Increasing application of DG on distribution networks is the direct impact of development of technology and the energy disasters that the world is encountering. To obtain these goals the resources capacity and the installation place are of a crucial importance. Line loss reduction is one of the major benefits of DG, amongst many others, when incorporated in the power distribution system. The quantum of the line loss reduction should be exactly known to assess the effectiveness of the distributed generation. In this paper, a new method is proposed to find the optimal and simultaneous place and capacity of these DG units to reduce losses, improve voltage profile too the total loss of a practical distribution system is calculated with and without DG placement and an index, quantifying the total line loss reduction is proposed. To demonstrate the validity of the proposed algorithm, computer simulations are carried out on actual power network of Kerman Province, Iran and the simulation results are presented and discussed.

Keywords: Distribution systems, Loss reduction index, DG placement, Imperialist Competitive Algorithm.

I. INTRODUCTION

The effect of DG on operating characteristics of the system such as electric losses, voltage profile, stability, and reliability needs to be appropriately assessed. The problem of DG allocation and sizing is importance crucial task. Installing DG units at no optimal places may result in an increase in system losses, costs, and therefore, having an undesired effect on the system. There may be many locations that do not have overload or voltage problems, where the DG can be located and provide the necessary control [5]. As a result, using an optimization method capable of indicating the best solution for a given distribution network can be very useful for system planning engineers. Selecting the best places for installing DG units and their preferable sizes in large distribution systems is an elaborate optimization problem. Therefore it is important to find optimal location and sizes of DGs in the system to achieve the above mentioned objectives. Distributed Generation (DG) may play an increasingly important role in the electric power system organization and market. Unlike traditional generation, the aim of distributed generation is to generate part of required electrical energy on small scale closer to the places of consumption and interchanges the electrical power with the network. This paper presents analysis of Imperialist Competitive Algorithm (ICA) based system power loss minimization approach and system energy loss minimization approach also the total loss of a practical distribution system is calculated with and without DG placement and an index, quantifying the total line loss reduction for optimal



International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 3, Issue 2, February 2014

sizing and placement of DG in electrical power systems. The methods are presented to find optimal size and bus location for placing DG using power loss and energy loss minimization in a networked system based on bus admittance, generation information and load distribution of the system. The proposed methods are tested by simulations actual power network of Kerman Province, Iran of 3-DG, 5-DG and 8-DG.

II. OBJECTIVE FUNCTION

The objective of DG placement in the distribution system is to minimize the annual cost of the system, subjected to certain operating constraints and load pattern. For simplicity, the operation and maintenance cost of the DG placed in the distribution system is not taken into consideration. The three-phase system is considered as balanced and loads are assumed as time invariant. Mathematically, the objective function of the problem is described as:

$$\text{Min } f = W_1 \times f_{\text{loss}}(r) + W_2 \times f_{\text{LRI}}(r)$$

The voltage magnitude at each bus must be maintained within its limits and is expressed as:

$$V_{\min} \leq |V_i| \leq V_{\max}$$

Where $|V_i|$ is the voltage magnitude of bus i , V_{\min} and V_{\max} are bus minimum and maximum voltage limits, respectively.

III. FORMULATION

The power flows are computed by the following set of simplified recursive equations derived from the single-line diagram depicted in Figure. 1.

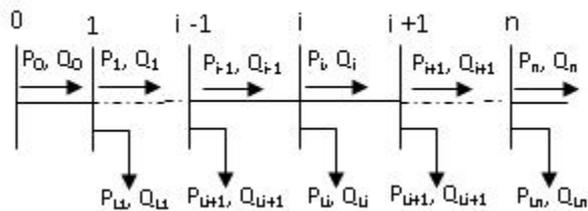


Figure 1: Single line diagram of main feeder

$$P_{i+1} = P_i - P_{L_{i+1}} - R_{ij+1} \frac{P_i^2 + Q_i^2}{|V_i|^2}$$

$$Q_{i+1} = Q_i - Q_{L_{i+1}} - X_{ij+1} \frac{P_i^2 + Q_i^2}{|V_i|^2}$$

$$|V_i|^2 = |V_{i+1}|^2 - 2(R_{ij+1} P_i + X_{ij+1} Q_i) + (R_{ij+1}^2 + X_{ij+1}^2) \times \frac{P_i^2 + Q_i^2}{|V_i|^2}$$

The power loss of the line section connecting buses i and $i+1$ may be computed as

$$P_{\text{Loss}}(i, i+1) = R_{i, i+1} \frac{P_i^2 + Q_i^2}{|V_i|^2}$$

The total power loss of the feeder, P_T^{LOSS} may then be determined by summing up the losses of all line sections of the feeder, which is given as

$$P_T^{\text{LOSS}} = \sum_{i=0}^{n-1} P_{\text{Loss}}(i, i+1)$$

Evolutionary algorithms are usually designed to maximize or minimize the objective function, which is a measure of the quality of each candidate solution [11]. After control variables are coded, the objective function will be evaluated. These values are the measures of quality, which is used to compare different solutions. The better solution joins the



International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 3, Issue 2, February 2014

new population and the worse one is neglected. Here Total Power Loss in the Distributed Generation is used in formulation of the objective function. Tray said objective function takes the following from:

$$\text{Min } f = W_1 \times f_{\text{loss}}(r) + W_2 \times f_{\text{LRI}}(r)$$

Where $f_{\text{loss}}(r)$ loss power for load is level r and $f_{\text{LRI}}(r)$ is energy not supplied for load is level r and W_1 is the weighting factor and can be written as following equations

$$f_{\text{loss}}(r) = C_N(r) \times E_{\text{loss}}(r)$$

Where $C_N(r)$ is the saving per MW reduction in the peak power loss and $E_{\text{loss}}(r)$ is loss power for load level r and is defined as equation

$$E_{\text{loss}}(r) = h_r \times \sum_{i=1}^n \sum_{j=1}^n R_{ij} |I_{ij}(r)|^2$$

Where R_{ij} and I_{ij} are resistor impedance between buses i and j , respectively. h_r is the duration of time. Loss reduction index (LRI), which quantifies the loss reduction with the insertion of DG, is defined as

$$f_{\text{LRI}}(r) = \frac{\text{Loss in the system with DG}}{\text{Loss in the system without DG}}$$

The inequality constraint on P_{DG_i} of each DG is given by:

$$P_{DG_i} \text{min} \leq P_{DG_i} \leq P_{DG_i} \text{max}$$

IV. IMPERIALIST COMPETITIVE ALGORITHM (ICA)

ICA mimics the social-political process of imperialism and imperialistic competition. ICA starts with an initial population of individuals, each called a country. Some of the best countries are selected as imperialists and the rest form colonies which are then divided among imperialists based on imperialists' power. After forming the initial empires, competition begins and colonies move towards the irrelevant imperialists. During competition, weak empires collapse and powerful ones take possession of more colonies. At the end, there exists only one empire while the position of imperialist and its colonies are the same [15]. The process ICA is depicted in Figure 2-4 and flow chart of proposed ICA is depicted in Figure 5. The flow chart of proposed method is depicted in Figure 6.

V. POWER FLOW ANALYSIS METHOD

The Backward Sweep calculates the current injected into each branch as a function of the end node voltages. It performs a current summation while updating voltages. Bus voltages at the end nodes are initialized for the first iteration. Starting at the end buses, each branch is traversed toward the source bus updating the voltage and calculating the current injected into each bus. These calculated currents are stored and used in the subsequent Forward Sweep calculations. The calculated source voltage is used for mismatch calculation as the termination criteria by comparing it to the specified source voltage. The Forward Sweep calculates node voltages as a function of the currents injected into each bus. The Forward Sweep is a voltage drop calculation with the constraint that the source voltage used is the specified nominal voltage at the beginning of each forward sweep. The voltage is calculated at each bus, beginning at the source bus and traversing out to the end buses using the currents calculated in previous the Backward Sweep [6].

VI. LOSS REDUCTION ANALYSIS

The total loss of the distribution system without DG is given by

$$\text{Loss}_{\text{without DG}} = \sum_{i=1}^{N-1} I_i^2 \times r \times L_i + \sum_{i=1}^{N-1} (P_{ci} + P_{Lvi})$$

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 3, Issue 2, February 2014

Where I_i is the current flowing through i th section, r is the resistance of line in ohms per unit length, L_i is the length of i th section, P_{ci} is the core loss of i th transformer, P_{Lvi} is the Losses on the low voltage side of the i th transformer and N is the number of busses in the system [17.23]. The total loss of the distribution system with DG is now

$$Loss_{with DG} = \sum_{i=1}^{K-1} (I_i - I_{DG})^2 r L_i + \sum_{i=k}^{N-1} I_i^2 r L_i + \sum_{i=1}^{N-1} (P_{ci} + P_{Lvi})$$

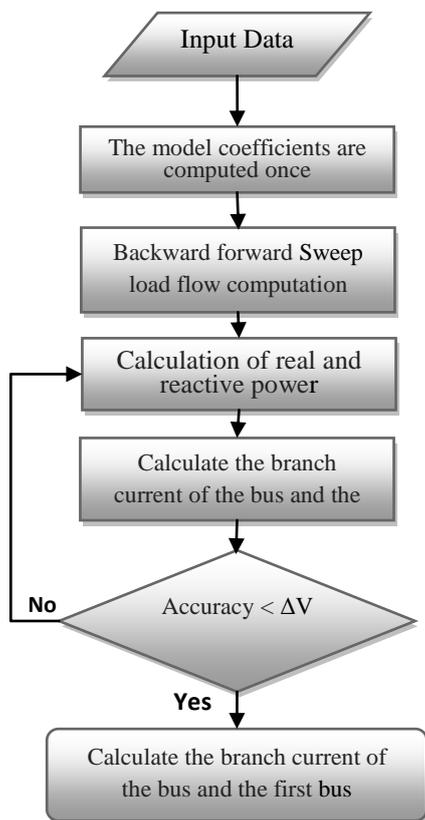


Figure 2: Flowchart of the proposed power flow

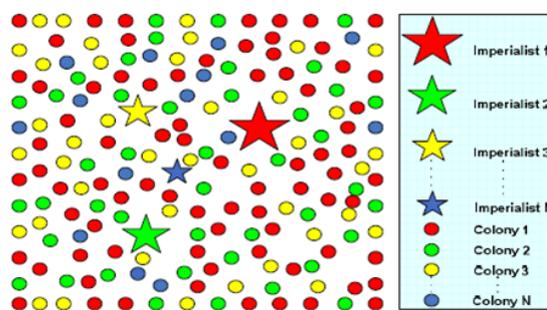


Figure 2: Creation of initial empires

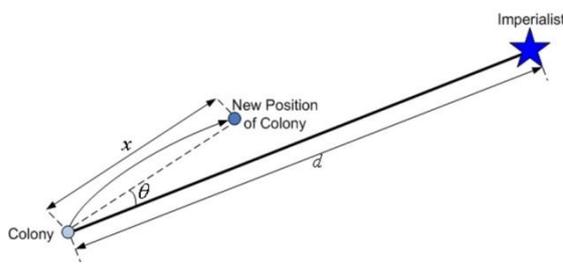


Figure 3: Colony movement toward his empires

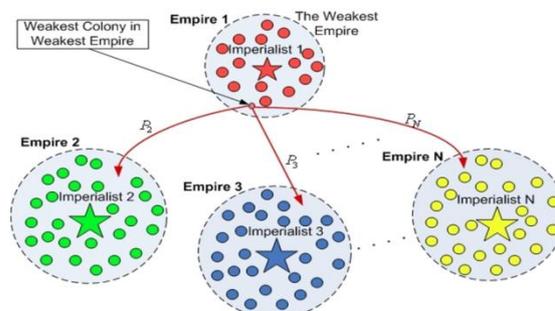


Figure 4: Take possession of the weakest colony and empires

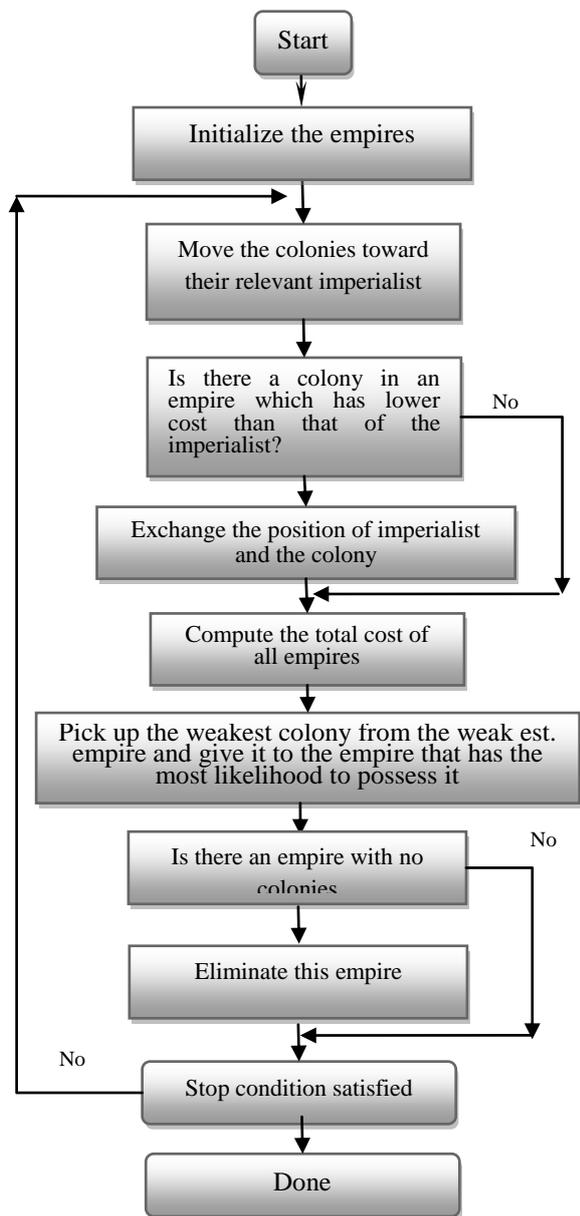


Figure 5: Flowchart of the proposed ICA algorithm

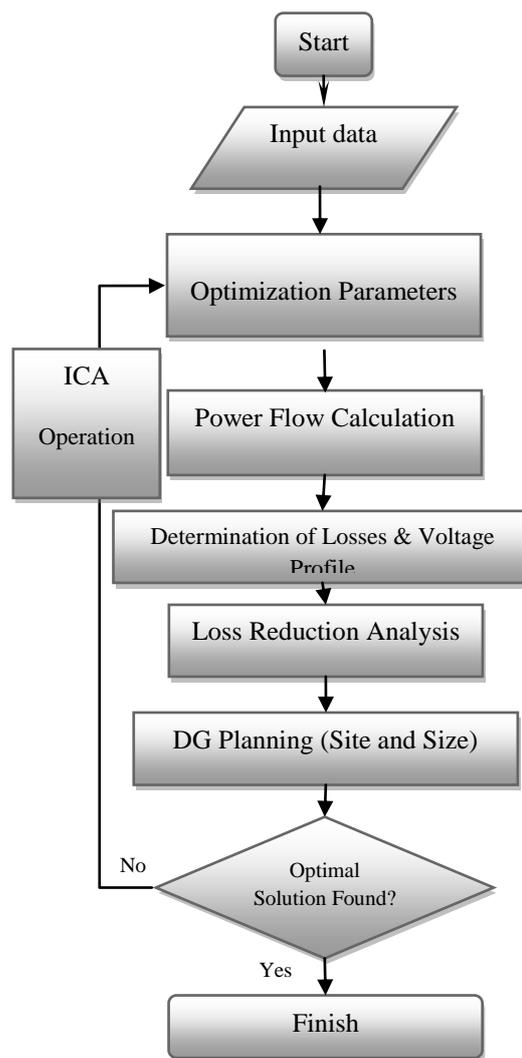


Figure 6: Flowchart of the proposed method

VII. TESTS AND RESULTS

To study the proposed method, actual power network of Kosar feeder of Kerman Province, Iran is simulated in MATLAB. Figure 7 illustrates the single-line diagram of this network. The base values of the system are taken as 20kV and 20MVA. The system consists of 20 distribution transformers with various ratings. The details of the distribution transformers are given in table 1. The details of the distribution conductors are given in Table 2. The total connected load on the system is 2550 KVA and the peak demand for the year is 2120 KVA at a PF of 0.8 lag.

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 3, Issue 2, February 2014

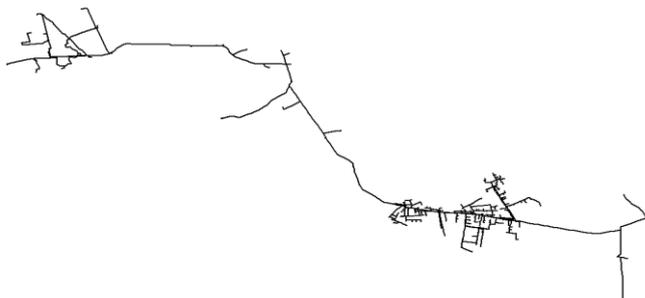


Figure 7: Single-line diagram of actual power network of Kosar feeder of Kerman Province in Cymedist

Table 1: Details of transformers in the system

Rating [KVA]	50	100	250
Number	5	9	6
No load losses [watts]	150	250	480
Impedance [%]	4.5	4.5	4.5

Table 2: Details of conductors in the system

Type	R [Ω /km]	X [Ω /km]	Cmax [A]	A [mm ²]
Hyena	0.1576	0.2277	550	126
Dog	0.2712	0.2464	440	120
Mink	0.4545	0.2664	315	70

Initially, a load flow was run for the case study without installation of DG. Table 3 depicts the locations and capacity of DG using Imperialist Competitive Algorithm. As it is clear, all the obtained values confines with all the considered constraints. The obtained penetration lever is 0.27, which is less than the assumed allowable value.

Table 3: Optimal place and capacity of DG

Location [#bus]	Capacity of DGs [Mw ; Mvar]
2	0.56 ; 0.35
4	0.68 ; 0.28
6	0.04 ; 0.3
14	0.25 ; 0.11
16	0.65 ; 0.38

In addition the total network loss, which was 10.05MW before installing DG, has diminished to the 4.55MW which shows 45.81% decrease. The detailed pu voltages profile and Percentage of loss of all the nodes of the system before and after DG placement with 5 DG units are shown in the Figure 8 and Figure 9.

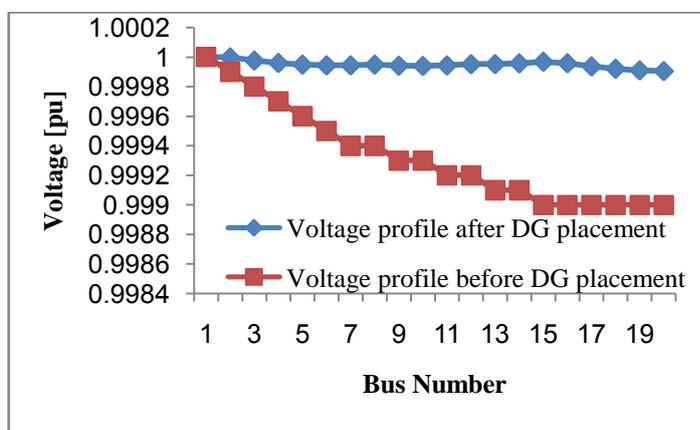


Figure 8: Voltage profile of 20 bus system before and after DG placement

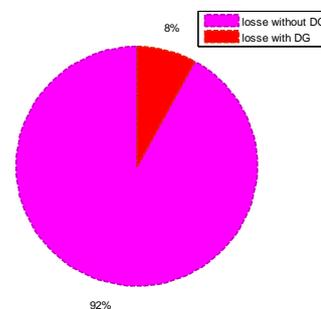


Figure 9: Percentage of loss before and after DG placement



International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 3, Issue 2, February 2014

The simulation results are given in Table 4. These results reveal that the inclusions of DG reduce the line losses as expected. It can be shown from the graphs that, LRI decreases marginally, since the core losses of the transformers and the LV side losses remain constant being independent of the presence of DG. It can also be seen that with the increase in the active power capacity of DG, LRI, decrease also with the increase in the number of DG, LRI, due to increasing of active power ,decrease.

Table 4: Variation of LRI

Number of DG	place	Picked P, Q [Mw;Mvar]	Type Range	LRI [%]
3	9,14,18	1.4297 ; 9.0745	a	0.0814
3	4,11,19	1.9530 ; 1.5130	b	0.0409
5	3,10,13,15,18	1.8696 ; 1.0473	a	0.0445
5	3,7,9,11,17	2.0725 ; 1.6090	b	0.0267
8	2,3,5,8,10,13,14,19	1.9477 ; 1.4219	a	0.0245
8	2,3,4,5,6,16,17,19	4.6356 ; 1.5240	b	0.4514

Note: type range is power domain as $a=2*b$

VIII. CONCLUSION

In the present paper, a new population based Imperialist Competitive Algorithm (ICA) has been proposed to solve DG placement problem and quantifying the total line loss reduction in distribution system. Simulations are carried on actual power network of Kerman Province, Iran. The simulation results show that the inclusion of DG, marginally reduce the losses in a distribution system. This is because; the line losses form only a minor part of the distribution system losses and the DG can reduce only the line losses. The other losses viz. the transformer losses and the LV side distribution losses remain unaltered. Hence this fact should be considered before installing a DG into a system. The results obtained by the proposed method outperform the other methods in terms of quality of the solution and computation efficiency.

REFERENCES

- [1] N.S. Rau and Y.H. Wan, "Optimal location of resources in distributed planning", IEEE Trans. Power System. Vol. 9, pp. 2014-2020, Nov.1994.
- [2] I.O. Elgerd, Electric Energy System Theory: an Introduction, McGraw Hill, 1971.
- [3] W. Krueasuk, W. Ongsakul, 'Optimal Placement of Distributed Generation Using Particle Swarm Optimization,' In Proceedings of IEEE Porto Power Technology, 2005.
- [4] M. Sedighzadeh, A. Rezazadeh, D. Dehghani and M. Mohammadi, "Distributed Generation Allocation to Improve Steady State Voltage Stability of Distribution Networks Using Clonal Selection Algorithm", International Journal of Engineering & Applied Sciences (IJEAS) Vol.3, Issue 2(2011)52-60
- [5] Dan Zhu, Robert P. Broadwater, Kwa-Sur Tam, Rich Seguin and Haukur Asgeirsson, "Impact of DG Placement on Reliability and Efficiency with Time-Varying Loads" IEEE Trans. on Power Systems, Vol. 21, No. 1, Feb 2006.
- [6] M. Mozaffari Legha, "Determination of exhaustion and junction of in distribution network and its loss maximum, due to geographical condition", MS.c Thesis. Islamic Azad University, Saveh Branch, Markazi Province, Iran, Feb 2011.
- [7] N. Medina, M.M. Qi, L. Butler-Purry, K.L. A Three Phase Load Flow Algorithm for Shipboard Power Systems (Sps), 2003.
- [8] D. Shir mohammadi, H.W. Hong, A. Semlyen, and G.X. Luo, "A compensation-based power flow method for weakly meshed distribution and transmission networks," IEEE Transactions on Power Delivery, Vol. 3, No. 2, pp.753-762, 1988.
- [9] W.El-hattam, M.M.A. Salma, "Distributed Generation Technologies, Definitions and Benefits" Electric Power System Research Vol. 71, pp. 119-1283, 2004.
- [10] H. Zareipour, K .Bhattacharya and C. A. Canizares, "Distributed Generation: Current Status and Challenges" IEEE Proceeding of NAPS 2004, Feb 2004.
- [11] N.Z. Mohd Ali, I. Musirin, Z. Khalidin, M.R. Ahmad, "Distributed Generation Sizing and Placement using Computational Intelligence", 2012 IEEE International Power Engineering and Optimization Conference (PEOCO2012), Melaka, Malaysia: 6-7 June 2012
- [12] Ramalingaiah Varikuti, Dr. M.Damodar Reddy, "Optimal Placement Of Dg Units Using Fuzzy And Real Coded Genetic Algorithm", Journal of Theoretical and Applied Information Technology.
- [13] Kennedy, J., Eberhart, R.: 'Particle swarm optimization'. Proc. 1995 IEEE Int. Conf. on Neural Networks, , pp. 1942-1948
- [14] Del Valle, Y., Venayagamoorthy, G.K., Mohagheghi, S.: 'Particle swarm optimization: basic concepts, variants and applications in power systems', IEEE Trans. Evol. Comput., 2008, 12, (2), pp. 171-195



ISSN (Print) : 2320 – 3765
ISSN (Online): 2278 – 8875

International Journal of Advanced Research in Electrical, Electronics and Instrumentation Engineering

(An ISO 3297: 2007 Certified Organization)

Vol. 3, Issue 2, February 2014

- [15] I. Ziari G. Ledwich A. Ghosh, "Optimal voltage support mechanism in distribution networks", IET Gener. Transm. Distrib., 2011, Vol. 5, Iss. 1, pp. 127–135
- [16] S.F.Attar, M.Mohammadi and R.Tavakkoli-Moghaddam, "A Novel Imperialist Competitive Algorithm to Solve Flexible Flow Shop Scheduling Problem in Order to Minimize Maximum Completion Time", International Journal of Computer Applications (0975 – 8887) Volume 28– No.10, August 2011
- [17] E. Vidyasagar, P.V.N.Prasad, "Impact of DG on Radial Distribution System Reliability", in 15th National Power System Conference Conference (NPSC), IIT Bombay 2008, pp 467-472
- [18] P. Chiradeja, "Benefit of distributed generation: A line loss reduction analysis," in *Proc. IEEE-Power Eng. Soc. Transmission and Distribution Conf. Exhib.: Asia and Pacific*, Dalian, China, Aug. 15–17, 2005.
- [19] Chiradeja, Ramkumar, "An Approach to quantify the Benefits of Distributed Generation Systems", IEEE trans. On Energy Conversion, Vol. 19, Dec 2004, pp 764 – 773.
- [20] M.A.Kashem, M.Negnevitsky, G.Ledwich, "Distributed Generation for minimization of power losses in distribution systems", IEEE conference 2006
- [21] Hugo A. Gil, Geza Joos, "Models for Quantifying the Economic Benefits of Distributed Generation", IEEE TRANSACTIONS ON POWER SYSTEMS, VOL. 23, NO. 2, MAY 2008, pp327-335
- [22] A.Kazemi, and M.Sadeghi, "Sitting and Sizing of Distributed Generation for Loss Reduction", Proc. Of Power and Energy Engineering Conference, APPEEC, 2009, Asia-Pacific, pp 1-4.
- [23] T. Ackermann, G. Andersson, and L. Soder, "Distributed generation: A definition," *Elect. Power Syst. Res.*, vol. 57, pp. 195–204, 2001

BIOGRAPHY



Mahdi Mozaffari Legha; PhD student of Power Engineering from Shiraz University, He is Trainer of department of Power Engineering, Javid University Jiroft, Iran. He is interested in the stability of power systems and electrical distribution systems and DSP in power systems. He has presented more than 15

journal papers and 50 conference papers.



Milad Askari Hashemabadi: MSc Student of Department of Power Engineering, Islamic Azad University of science and Research Kerman branch, Iran. He is interested in the stability of power systems and power quality in distribution systems.



Vajihe Sharifi: was born in Rafsanjan. She is Trainer of Department mathematics, Rafsanjan Branch, Islamic Azad University, Iran. She received the M.Sc. from Vali-e-Asr University.



Hassan Javaheri; was born in Rafsanjan, Ira. He is Trainer of department of Power Engineering, Javid University Jiroft, Iran. He received the M.Sc. from Bu-Ali Sina University. He is interested in the stability of power systems and electrical distribution systems and power electronics



Mohammad Mozaffari Legha; was born in Kerman, Ira. He received the B.Sc. from Islamic Azad University Kerman Branch. He is interested in the stability of power systems and power distribution systems, reliability and power electronics.